


MD/MT HIGH RANGE COMPOUND SWITCHES




MD

CE



PRESSURE CAPSULE DETAILS


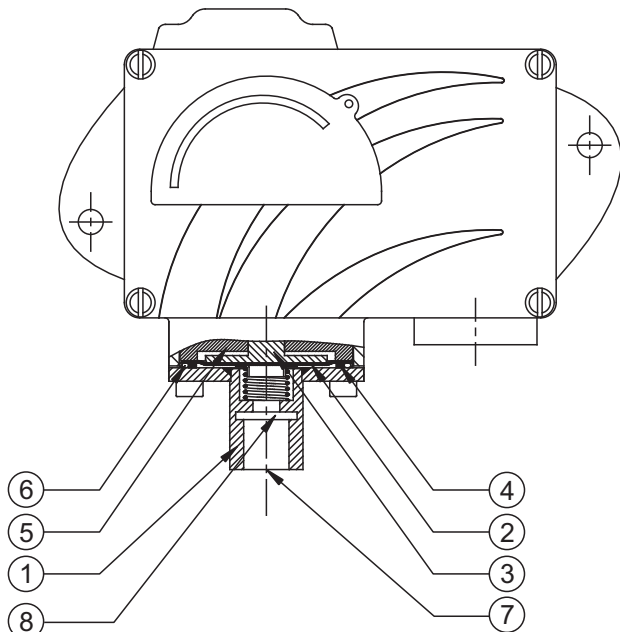


No. Description

1. Pressure Housing (SS316)
2. Diaphragm (PTFE®)
3. Plunger (SS)
4. Steel Ring (SS316)
5. O-Ring (PTFE®)
6. Disc (Al)
7. Bottom Spring (SS)
8. Support Plunger (SS)

Note : wetted parts are mentioned in italics.

INSTALLATION DRAWING

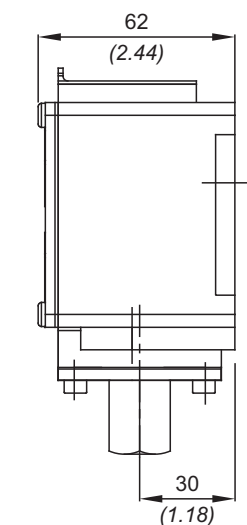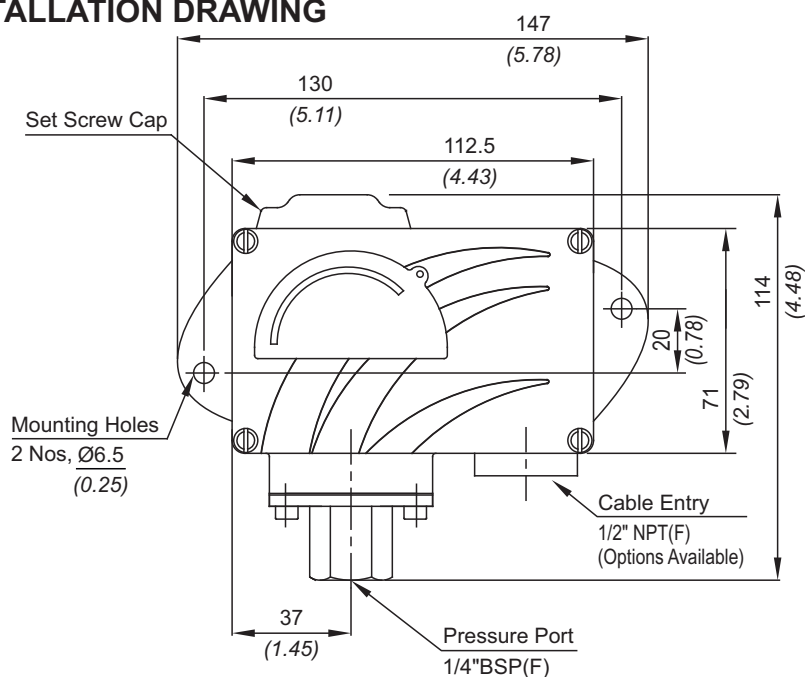

APPROX. DIMENSIONS IN $\frac{\text{mm}}{\text{inches}}$

MD/MT HIGH RANGE COMPOUND SWITCHES

RANGE SELECTION TABLE

Range Code	Range bar (psi)	Differential* bar (psi)	Maximum Working Pressure bar (psi)
		Approximate Maximum for "A1" microswitch	
C01	-1 to 1.0 (-14.50 - 14.50)	0.2 (2.90)	12 (174.05)
C02	-1 to 1.5 (-14.50 to 21.75)	0.3 (4.35)	12 (174.05)
C03	-1 to 2.6 (-14.50 - 37.71)	0.4 (5.80)	12 (174.05)
C04	-1 to 3.6 (-14.50 - 52.26)	0.6 (8.70)	12 (174.05)
C07	-1 to 7 (-14.50 - 101.526)	0.8 (11.60)	12 (174.05)

Note:

1. The minimum differential increases with the setpoint. The differential values mentioned in the above table are approximate maximum for FSR. The differential value will vary according to the pressure range selected and microswitch type. For actual values of differential please contact sales office.

2. When using 2SPDT switching arrangement, both microswitches may not actuate and/or deactuate at the same point. A small stage gap, normally upto +/- 5% FSR (depending on range code) may be observed. The On-Off differential (hysteresis) typically tends to be atleast double of those published for 1SPDT pressure switches.

If actuation and/or deactuation at same point is critical part of operation, then it can be achieved by using a separate DPDT relay. This relay will need a separate power supply for it's coil.

HOW TO ORDER INDUSTRIAL HIGH RANGE COMPOUND SWITCHES

Group 1	Group 2	Group 3	Group 4	Group 5	Group 6	Group 7	Group 8
Non standard allocation	Gas Group Classification	Cable Entry Size	Switch Type	Range Code (values in bar)	Microswitch Type	Pressure Port Material / Size	Diaphragm
☐ A prefix "N" is used in the model code in case of any non standard options / accessories that are provided with the switches. Will be given by manufacturer, only after agreement of supply details with customer. The prefix is subject to change as per specific requirement.	MD = Industrial pressure switch with IP66 rated enclosure as per IS/IEC 60529 MT = Industrial pressure switch with IP66 rated enclosure as per IS/IEC 60529	1 = Al. enclosure ½" NPT threads *2 = Al. enclosure ¾" NPT threads 3 = Al. enclosure M20 X 1.5 threads 7 = SS enclosure, ½" NPT threads *8 = SS enclosure, ¾" NPT threads 9 = SS enclosure, M20 X 1.5 threads	CF1 = compound switch, fixed differential without scale CF2 = compound switch, fixed differential with scale in bar *CA1 = compound switch, adjustable differential without scale *CA2 = compound switch, adjustable differential with scale in bar	C01 = (-1 to 1.0) C02 = (-1 to 1.5) C03 = (-1 to 2.6) C04 = (-1 to 3.6) C07 = (-1 to 7)	A1 = General purpose microswitch, rated at 15 A; 250 VAC *A6 = Adjustable deadband *A7 = 2SPDT switching elements *A8 = General purpose microswitch *A9 = General purpose microswitch *B7 = 2SPDT Switching Elements *B9 = 2SPDT Switching Elements for adjustable differential 		

eg. An industrial switch for gas group IIC, with 1/2" NPT cable entry in aluminium housing as 1SPDT pressure switch, having -1 bar to +1 bar pressure range, with 15 Amp. microswitch, SS316 pressure housing with 1/4" BSP port size & Neoprene diaphragm shall be specified by

Group 1	Group 2	Group 3	Group 4	Group 5	Group 6	Group 7	Group 8
☐	MD	1	CF1	C01	A1	S1	0

Please specify full model number to avoid ambiguity. If only the first two groups are specified while ordering, uncalibrated switches with standard wetted parts and enclosures will be supplied.

HIGH RANGE COMPOUND SWITCHES

MD/MT